


INTEGRAL DRIVER WIRING - 1 DRIVER

D, DL5, DL1, DE, DD1, DDE Driver Options

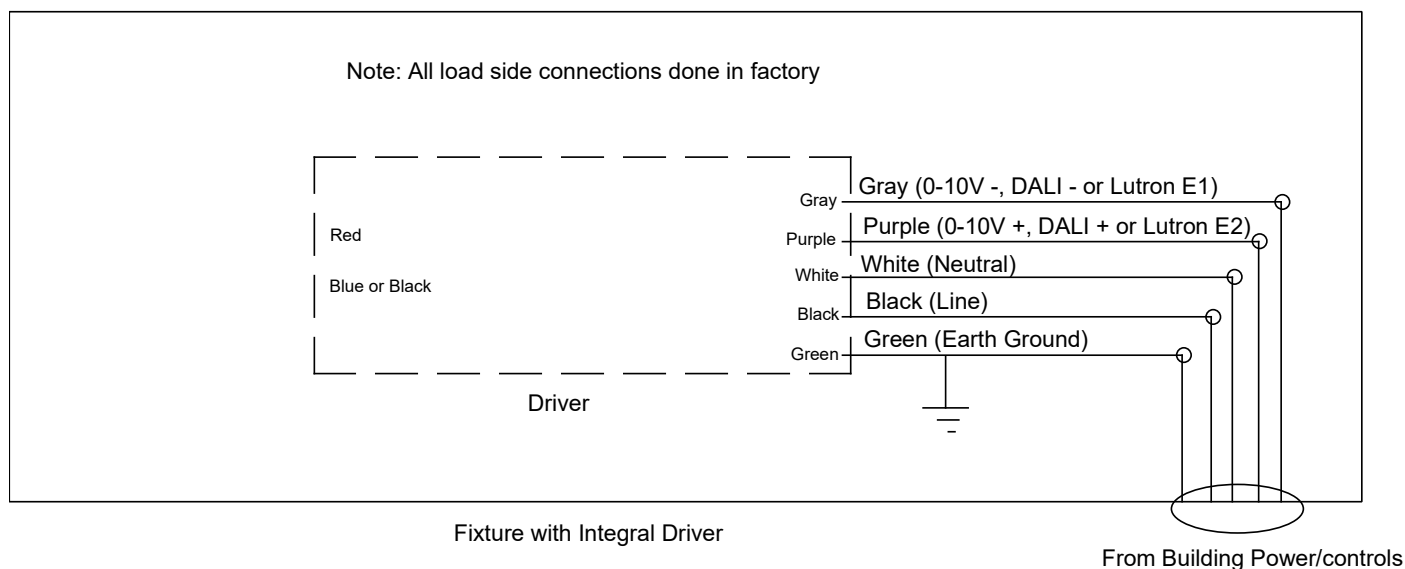

WARNING

RISK OF FIRE AND ELECTRICAL SHOCK.

THIS PRODUCT MUST BE INSTALLED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND ALL LOCAL CODES BY A QUALIFIED ELECTRICIAN. DISCONNECT POWER AT ELECTRICAL PANEL BEFORE INSTALLING OR SERVICING.

All wiring must be in accordance with the National Electrical Code and all local codes.

Grounding must be in accordance with NEC article 250.

Plenum wiring between Class 2 remote driver and luminaire canopy must be minimum 18 AWG and must be in accordance with NEC article 725.